


1.77
3.01

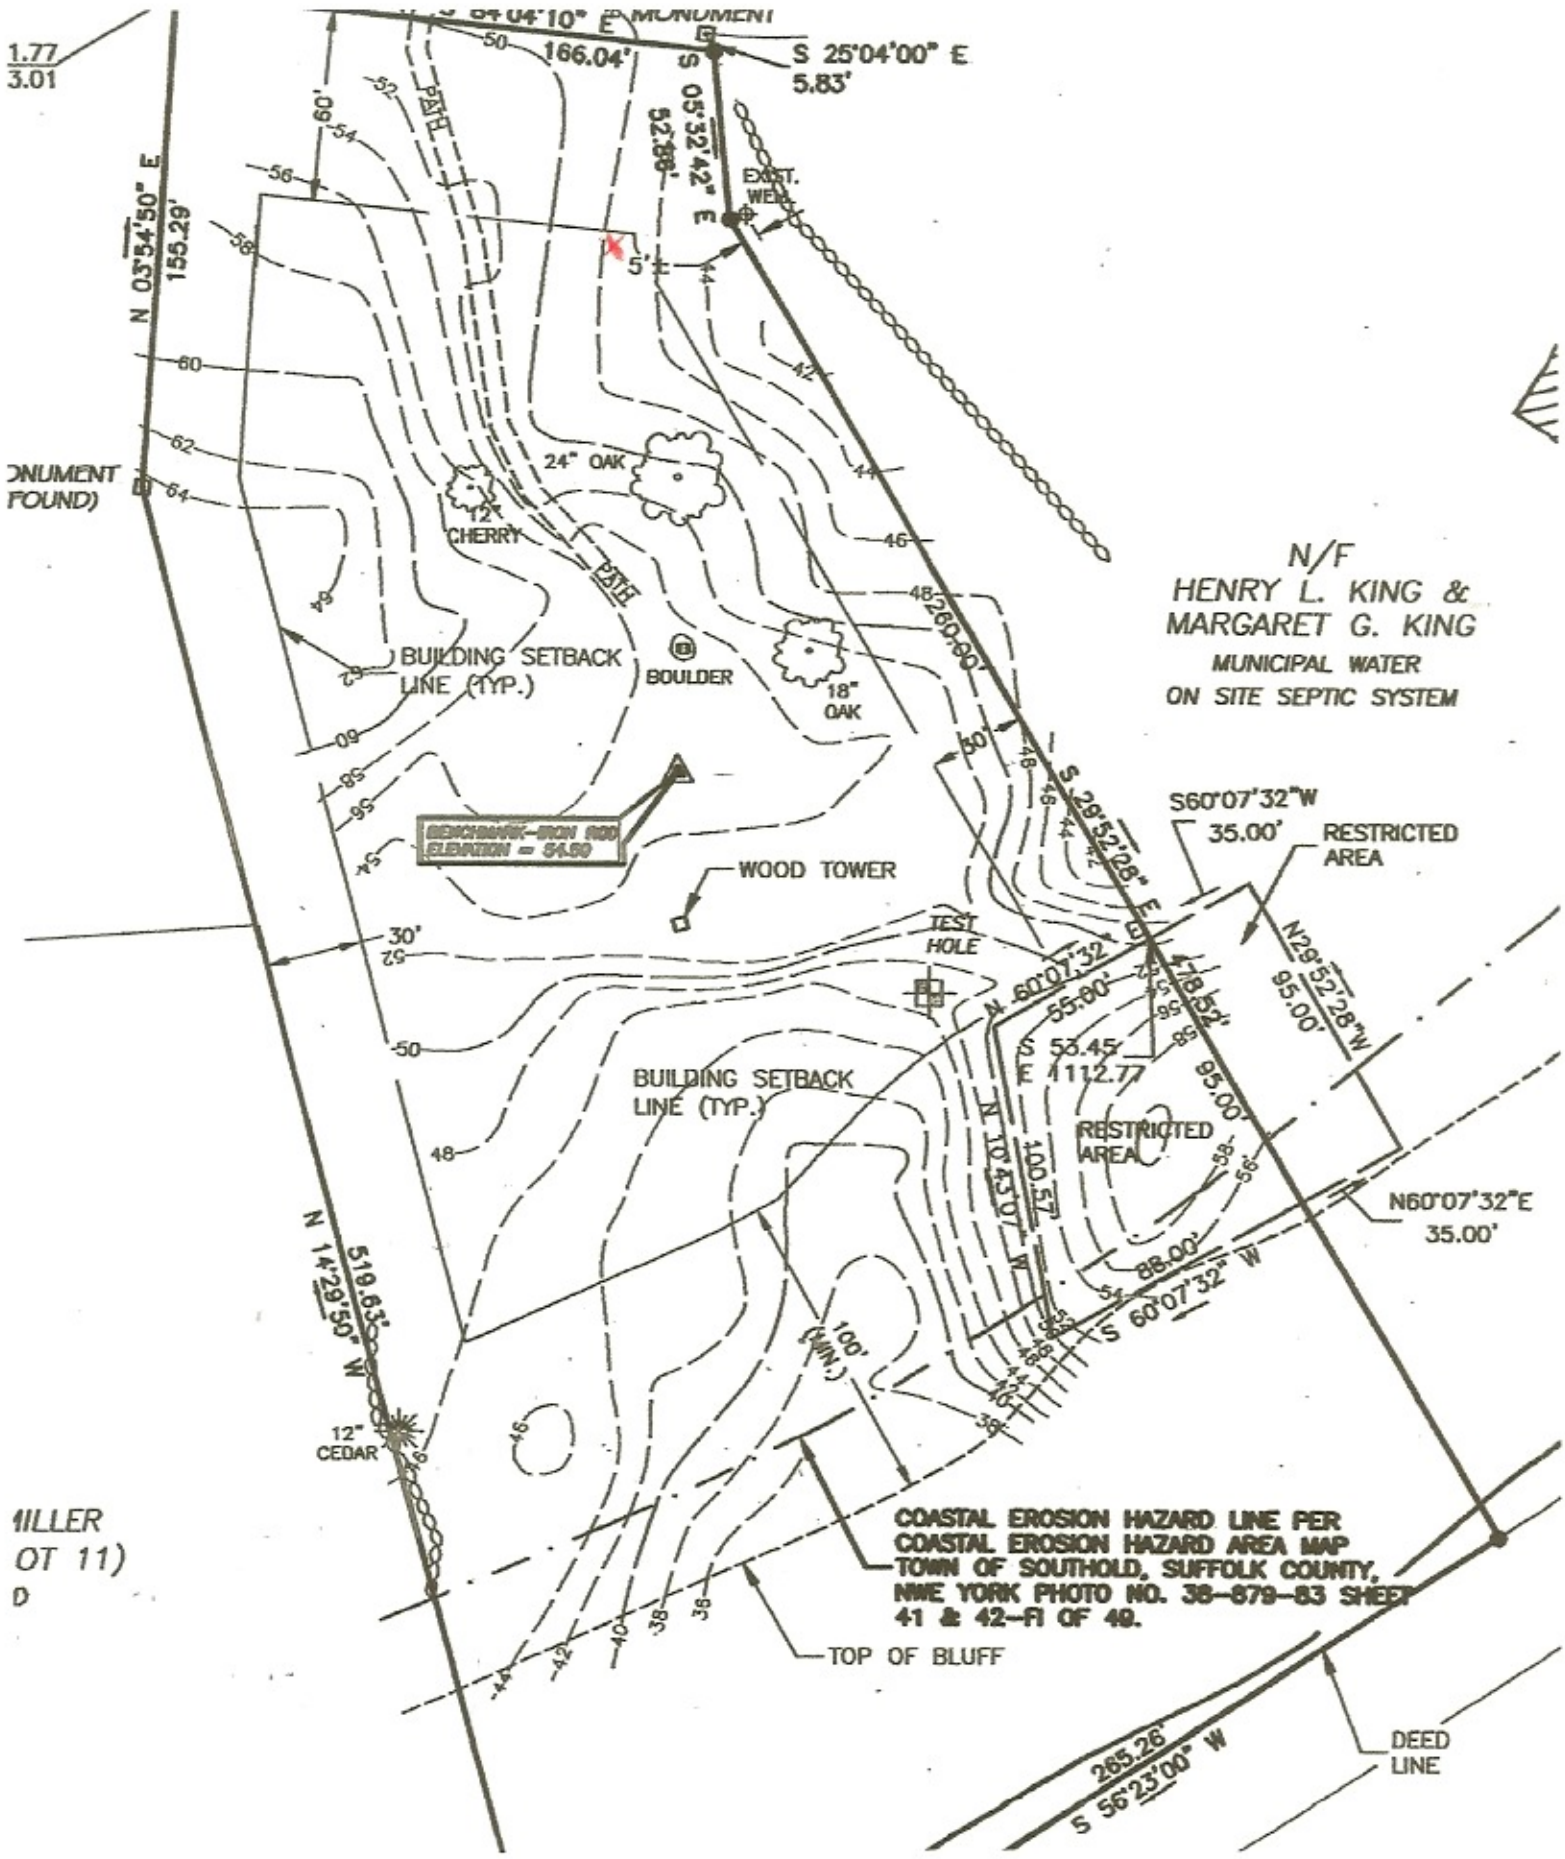

N/F
HENRY L. KING &
MARGARET G. KING
MUNICIPAL WATER
ON SITE SEPTIC SYSTEM

MILLER
OT 11)
D

8/20/2009